

Fire Resisting Service Enclosure

BS EN 1366-5:2021

Manufactured
with
**GREEN
STEEL***

The Harcom[®] Fire Resisting Service Enclosure has been tested in both horizontal and vertical orientations to comply with the latest BS EN 1366-5:2021 standard.



Successfully meeting all requirements for integrity and insulation, providing 120 minutes of fire resistance from both internal and external fires. Preventing a temperature increase of 140°C above ambient as an average or no more than 180°C localised point.

The Harcom[®] Fire Resisting Service Enclosure has been additionally tested in accordance with BS EN 60529:1992+A2:2013, achieving IP5X dust protection and IPX6 protection against powerful water jets.

Designed with prefabricated modular sections for easy installation, the services are mounted into the lid and connected to internal channels. The underside then closes securely to fully enclose the services. This construction protects the services from external fire exposure and prevents fire from spreading between compartments through which the enclosure passes, even if a fire starts inside the enclosure.

This ensures compartmentation remains intact throughout the building, offering reassurance for the safe evacuation of occupants and providing clear access for fire-fighting teams.

For more information:

 +44 (0)20 7422 1959  info@harcomgroup.co.uk  www.harcomgroup.co.uk

*Enclosure casings are manufactured using de-carbonised steel. Offering a 65% Co2e material reduction.



Fire Resisting Service Enclosure

BS EN 1366-5:2021



KEY FACTS:

PRODUCT TYPE/APPLICATION:
Service Enclosure

DESCRIPTION:
BS EN 1366-5:2021 Fire Resisting service enclosure for up to 120 minute integrity and insulation to the EN 1363-1 fire curve

TEST SIZE/DIMENSIONS:
Horizontal Max. 1500x500mm
Vertical Max. 1200x500mm

BUILDERS WORK OPENING:
Max. 100mm around enclosure

WEIGHT:
98kg/m (600x300x1000mm)
+ Max. 100kg/m services

FIRE CLASSIFICATIONS:
EI120 (Ve Ho o>i)
EI120 (Ve Ho i>o)

ADDITIONAL TESTING:
BS EN 60529:1992+A2:2013
IP5X (against foreign objects & dust)
IPX6 (against powerful water jets)

MATERIAL:
De-carbonised steel casing with internal fire resisting lining

**CHEMICAL PROPERTIES/
SAFETY DATA SHEETS:**
Silcate-free plaster based lining.
MSDA available upon request.

SAFE MANUAL AND MECHANICAL HANDLING:

- Do not attempt to lift loads that exceed safe manual handling limits. When lifting, bend at the knees and keep back muscles relaxed.
- Avoid bending the back or twisting the body while lifting or carrying loads.
- Use suitable mechanical lifting equipment wherever possible, such as pallet trucks, hoists, skates, rollers, forklifts, or similar approved equipment.
- Ensure sufficient numbers of personnel are available for the task, including two-person lifts where required.
- Be aware of the risk of trapped fingers and feet. Appropriate personal protective equipment (PPE) shall be worn in accordance with site guidelines.

DELIVERY:

- A trained banksman is recommended during vehicle reversing and unloading operations.
- Segregation between vehicles and site operatives shall be maintained at all times.
- Delivery drivers must comply with all site-imposed speed limits and traffic management arrangements.
- Site operatives not directly involved in delivery or off-loading activities must be kept clear of delivery and reversing areas.
- Mechanical lifting equipment should be used wherever practicable, including tail lifts, forklifts, site cranes, and pallet trucks.

SAFE STORAGE:

- Enclosures shall be moved immediately to the work area or an agreed designated storage location.
- To achieve the required PDI Intermediate Level of cleanliness and minimise the risk of contamination, storage areas must be clean, dry, and protected from site dust in accordance with TR/19 guidance.
- Where necessary, storage provisions may include boarded flooring, pallets, and water-resistant protective coverings.
- Must be stored clear of standing water, dirt, and building materials, and shall be protected from rainfall at all times.

INSTALLATION:

Safe Installation & Access:

Safe access routes to the work face shall be provided and maintained at all times. The work area must be kept clean, free from debris, and adequately ventilated and lit. Installation shall only be carried out by trained and competent operatives.

Interface with Other Products:

Refer to the relevant wall and service penetration details where applicable.

Competence Requirements:

Installation must be undertaken by operatives holding appropriate third-party accreditation, such as FIRAS training or certification to LPS 1531.

Inspection, Testing & Record Keeping:

Ongoing inspections shall be undertaken by FIRAS-trained supervisors. The system must be inspected and signed off prior to handover. System certification shall be issued upon completion of the works.

Sequencing of Works:

Installation sequencing shall be in accordance with project requirements and typically follows:

- Lid
- Services (by others)
- Underside

MAINTENANCE:

(IN ACCORDANCE WITH BS 9999:2017)

Harcom® systems may not maintain the required level of performance if they are not regularly inspected, tested, and maintained. Continued reliability of Harcom® systems is essential.

Harcom® systems may be compromised by subsequent works carried out by other trades. The later installation of services such as electrical and IT cabling, or building services pipework, can significantly affect the integrity of fire compartments. Works should not be signed off until Harcom® systems have been checked and confirmed as fully functional following such works.

Effective maintenance of Harcom® systems is equally important both internally and externally to the building. Any materials used for repair or modification must not impair the overall fire safety strategy.

WARRANTIES, GUARANTEES & INSURANCE:


Unauthorised modification to the Harcom® system, including alterations to penetration seals, will invalidate the certificate of conformity.

INSPECTION & MAINTENANCE SCHEDULE:

Harcom® recommends that the system is inspected by a competent person:

- Following any works carried out in the vicinity by others
- As a minimum, on an annual basis

Any damage identified should be reported to the original installer so that an assessment can be undertaken and remedial works carried out where necessary.

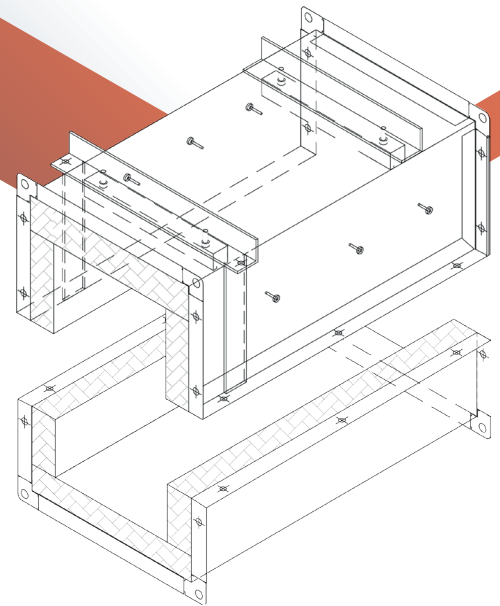

CLEANING REQUIREMENTS:

To maintain cleanliness, the Harcom® system should be cleaned using a vacuum cleaner fitted with a soft brush attachment.

Do not use:

- Wire brushes
- Chemical cleaners
- High-pressure steam or water jetting systems

MODIFICATIONS:

Any modifications to the Harcom® system must be carried out by an approved installer only.

RECORD KEEPING:

All inspections, maintenance activities, and any changes to the Harcom® system shall be recorded and retained by the project's Responsible Person.

DISPOSAL:

End of life information:

Life of building (50 years*).

Recycling:

Internal lining board can be removed by mechanical means. not recyclable - not incinerable. Storage in class III landfill or according to local regulations that may apply. Do not store as a mixture with organic waste. The enclosure casings recyclable, always follow local authority guidelines.

Packaging: delivered on wooden pallets which can be reused, incinerated or recycled. Always follow local authority guidelines.

* Based on internal installation in a dry and non-humid environment.